


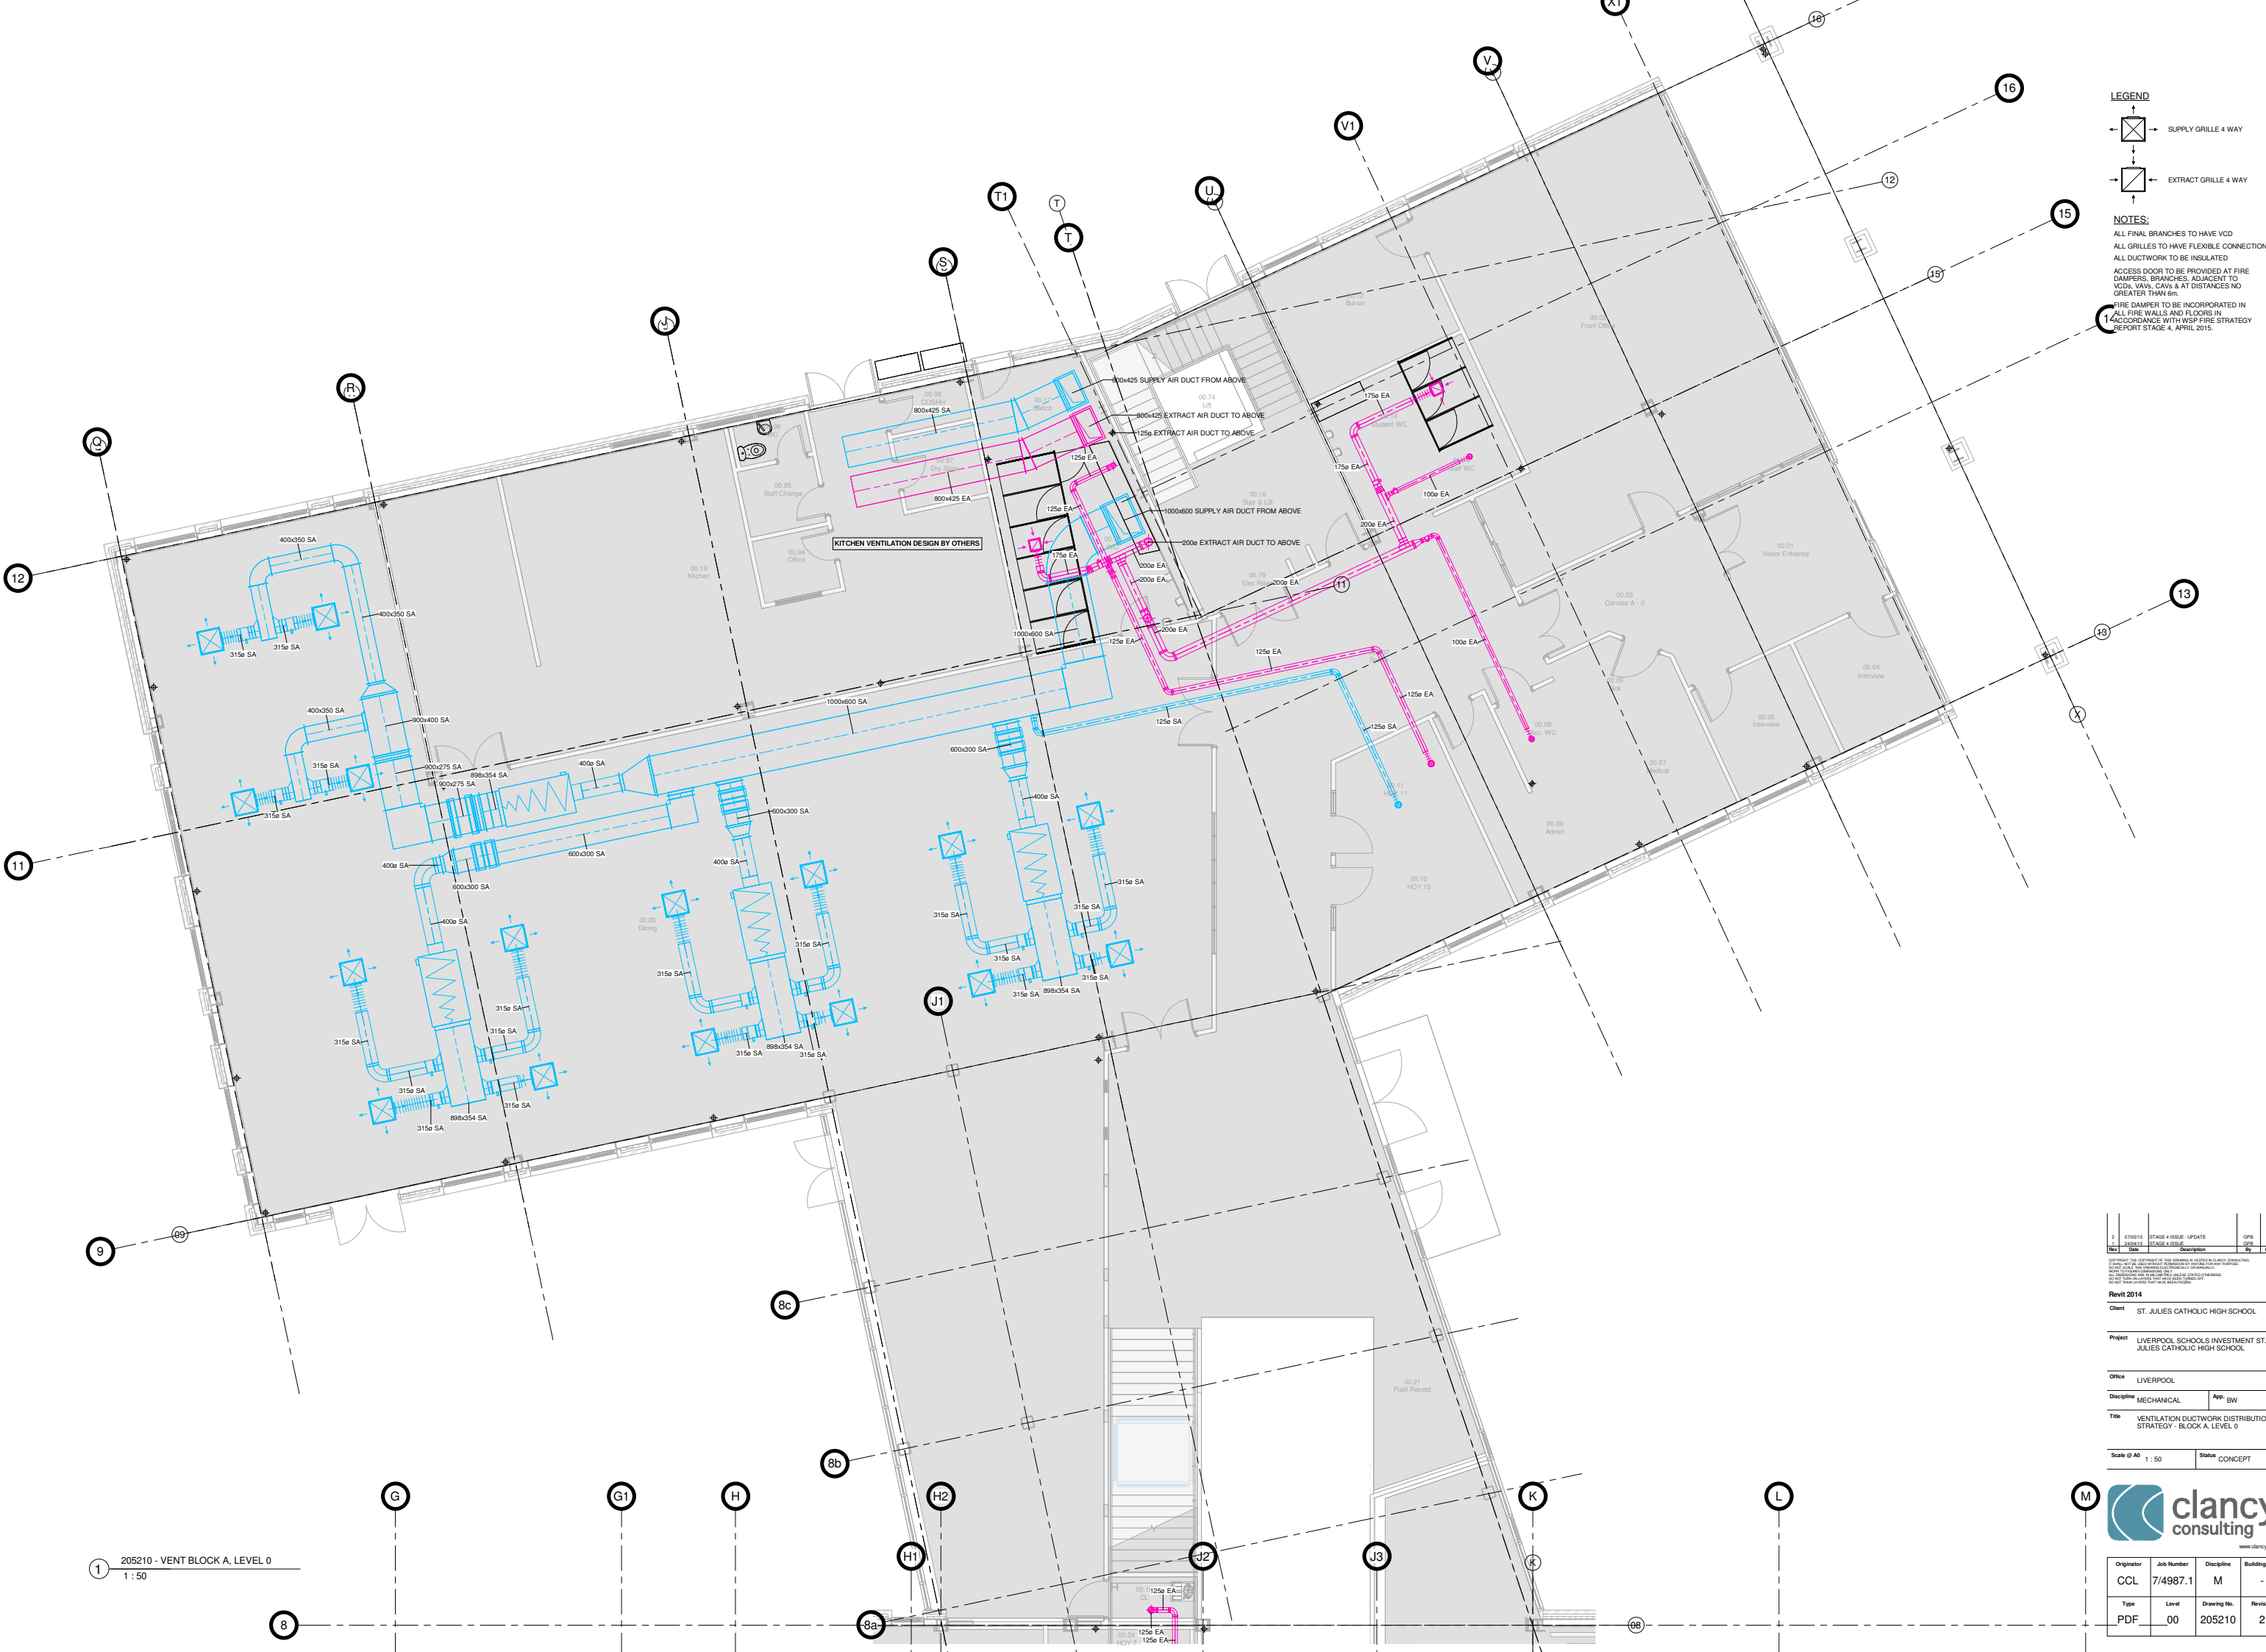

LEGEND

→ [Symbol] → SUPPLY GRILLE 4 WAY

← [Symbol] ← EXTRACT GRILLE 4 WAY

NOTES:

ALL FINAL BRANCHES TO HAVE VCD

ALL GRILLES TO HAVE FLEXIBLE CONNECTIONS

ALL DUCTWORK TO BE INSULATED

ACCESS DOOR TO BE PROVIDED AT FIRE DAMPERS, BRANCHES, ADJACENT TO VCDs, VALVE, CANV & AT DISTANCES NO GREATER THAN 6m.

FIRE DAMPER TO BE INCORPORATED IN ALL FIRE WALLS AND FLOORS IN ACCORDANCE WITH WSP FIRE STRATEGY REPORT STAGE 4, APRIL 2015.

1 205210 - VENT BLOCK A, LEVEL 0
1:50

2	6/10/15	STAGE 4 ISSUE - UPDATE	QPR	DR
Rev	Date	Description	By	Check
1	6/10/15	STAGE 4 ISSUE - UPDATE	QPR	DR

Copyright: The copyright of this drawing is vested in Clancy Consulting. It is not to be used for any other purpose without the written consent of Clancy Consulting. It is not to be used for any other purpose without the written consent of Clancy Consulting. It is not to be used for any other purpose without the written consent of Clancy Consulting.

Revit 2014

Client: ST. JULIES CATHOLIC HIGH SCHOOL

Project: LIVERPOOL SCHOOLS INVESTMENT ST. JULIES CATHOLIC HIGH SCHOOL

Office: LIVERPOOL

Discipline: MECHANICAL App: BW

Title: VENTILATION DUCTWORK DISTRIBUTION STRATEGY - BLOCK A, LEVEL 0

Scale @ A1: 1:50 Status: CONCEPT

clancy consulting
www.clancy.co.uk

Originator	Job Number	Discipline	Building/Zone
CCL	7/4987.1	M	-
Type	Level	Drawing No.	Revision
PDF	00	205210	2