


Ground Floor





Extra items required to comply with Approved Document M4(2) shown in blue.

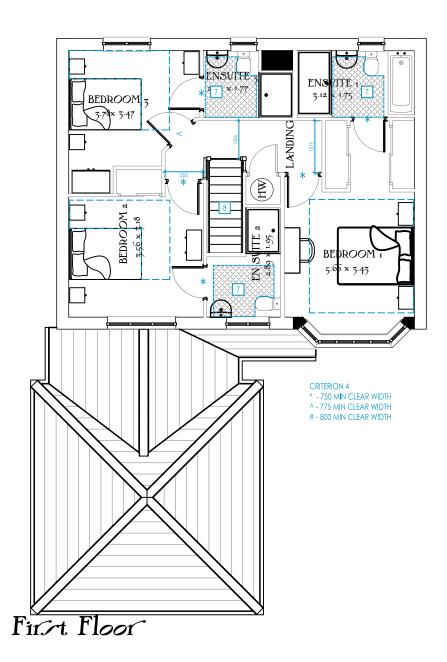

Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Canterbury Life_tyle M4(2)

Heritage Collection "2017 Edition"

EF Series 1505sqft 139.79m² DATE: November 2019 REV: -


EF_CANTQ_M42_DM.6

Drawing Scale 1:100 @ A3





Front Elevation

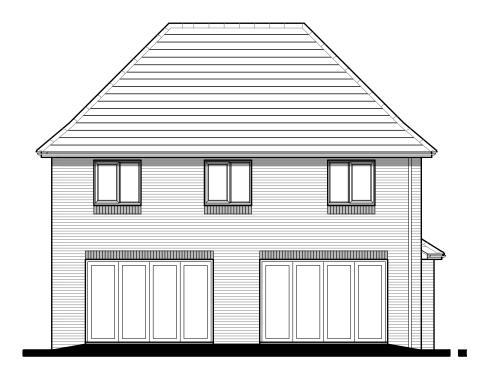

Rear Elevation



Side Elevation



Side Elevation



Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Canterbury Life_tyle M4(2)


Heritage Collection "2017 Edition"

EF Series Brick (B1) 1505sqft 139.79m² DATE: November 2019 REV: -


EF_CANTQ_M42_DM.6

Drawing Scale 1:100 @ A3



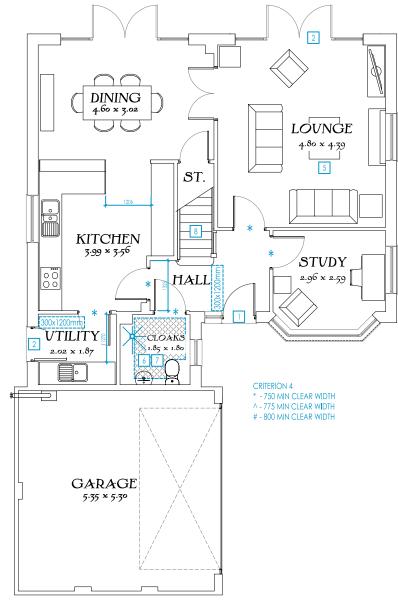

Ground Floor

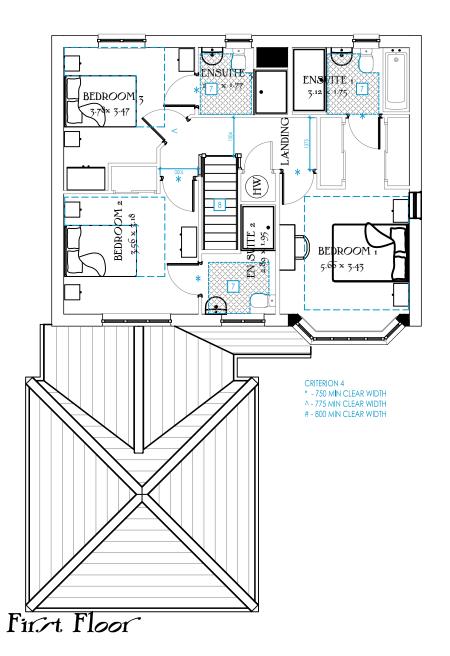



Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have:
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured
 450mm above the pitch line (ignoring any newel post).

The Canterbury Life_tyle M4(2) (Cnr)

Heritage Collection "2017 Edition"

EF Series 1505sqft 139.79m² DATE: November 2019 REV: -

EF_CANTQ_M42_DM.6

Drawing Scale 1:100 @ A3





Front Elevation



Rear Elevation



Side Elevation



Side Elevation



Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm
- Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access
- 7. Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Canterbury Life_tyle M4(2) (Cnr)


Heritage Collection "2017 Edition"

EF Series Brick (B1) 1505sqft 139.79m² DATE: November 2019 REV: -


EF_CANTQ_M42_DM.6

Drawing Scale 1:100 @ A3



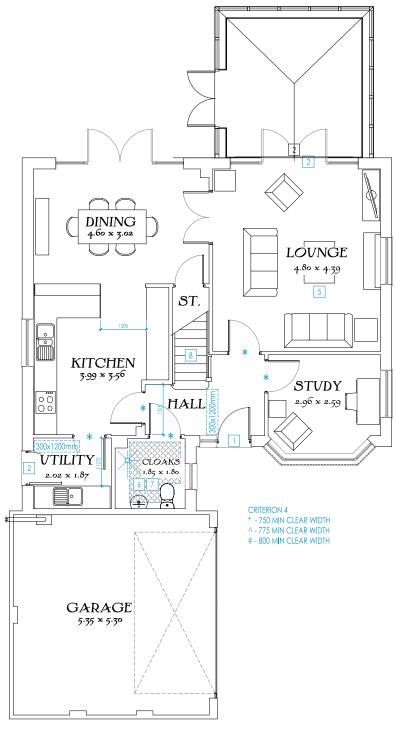

Ground Floor

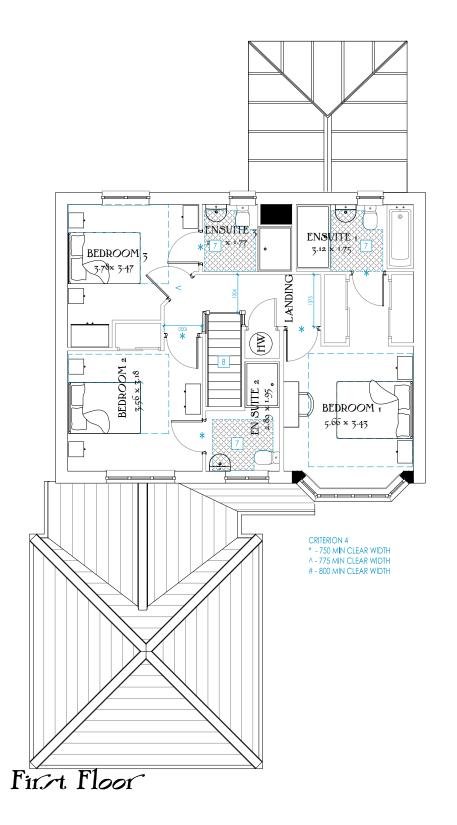



Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- 1.3. Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- Entrance level living space
- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured
 450mm above the pitch line (ignoring any newel post).

The Canterbury Life_tyle M4(2) Con_ervatory

Heritage Collection "2017 Edition"

EF Series 1505sqft 139.79m² DATE: November 2019 REV: -

EF_CANTQ_M42_DM.6

Drawing Scale 1:100 @ A3





Front Elevation



Rear Elevation

Side Elevation



Side Elevation



Extra items required to comply with Approved



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm
- Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured
 450mm above the pitch line (ignoring any newel post).

The Canterbury Life_tyle M4(2) (Conservatory)

Heritage Collection "2017 Edition"

EF Series Brick (B1) 1505sqft 139.79m² DATE: November 2019 REV: -

EF_CANTQ_M42_DM.6

Drawing Scale 1:100 @ A3

