

FAMILY/DINING 6.84 × 3.33

ST

HALL

UTILITY1


CLOAKS

KITCHEN 000






Rear Elevation

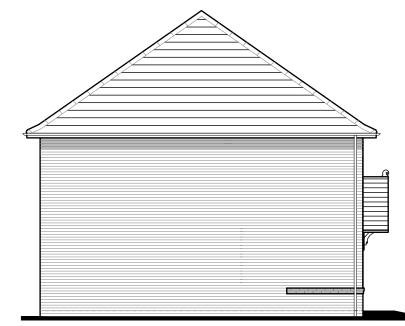

Side Elevation

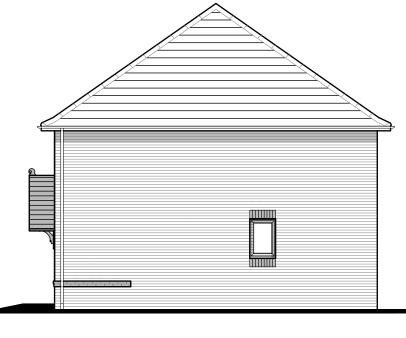

Side Elevation

Key:-

Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post)

The Hariogate M4(2)

Heritage Collection "2017 Edition"

EF Series Brick (B1) 1555sqft 144.46m² DATE: November 2019 REV: -

EF_HARR_M42_DM.6

Drawing Scale 1:100 @ A3

Ground Floor

LOUNGE

4.43 × 3.65 5


CRITERION 4 * - 750 MIN CLEAR WIDTH

^ - 775 MIN CLEAR WIDTH # - 800 MIN CLEAR WIDTH


First Floor





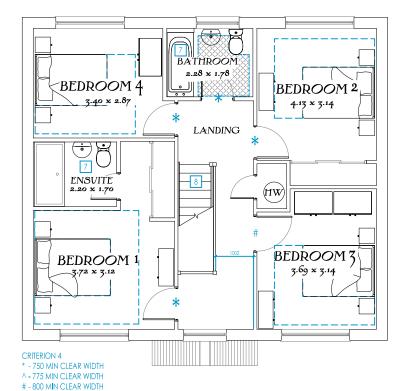

First Floor

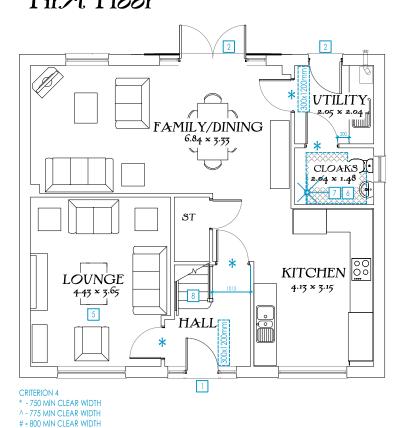


Ground Floor




Front Elevation



Rear Elevation

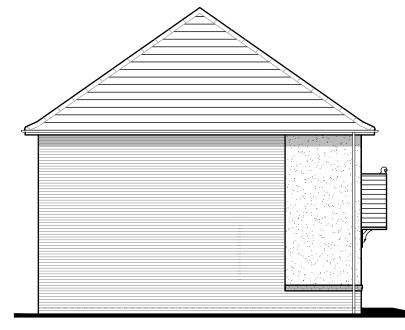

Side Elevation

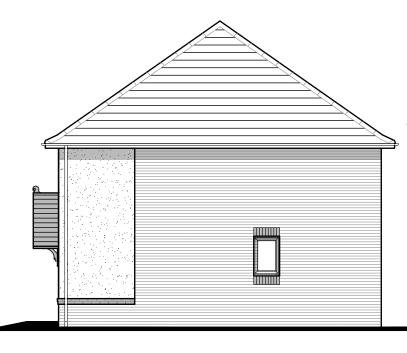

Side Elevation

Key:-



Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion



Number indicates item related to AD-M4(2) Criter

Approved Document M4(2) Criteria

- 1. Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- B. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Hangate M4(2)


Heritage Collection "2017 Edition"

EF Series Render (A1) 1555sqft 144.46m² DATE: November 2019 REV: -

EF_HARR_M42_DM.6

Drawing Scale 1:100 @ A3



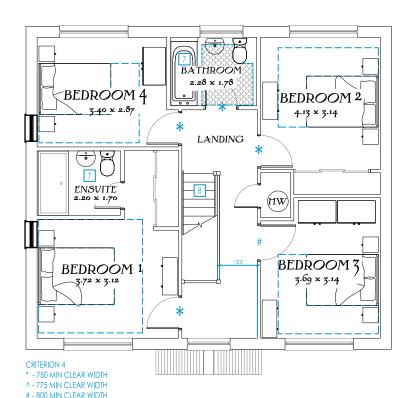





1.1. 1200 x 1200mm level external landing covered for

Approved Document M4(2) Criteria 1. Principal entrance to have

Lighting on dusk to dawn or PIR sensor. Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.

Extra items required to comply with Approved Document M4(2) shown in blue.

Number indicates item related to AD-M4(2) Criterion

Clear space required in WC & Bathroom.

- All other external doors must comply with paragraph 1.3
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space


Key:-

- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post)

Front Elevation


Rear Elevation



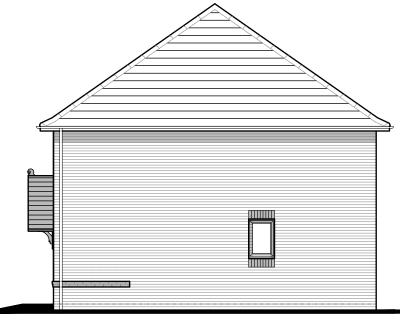

Side Elevation

Side Elevation

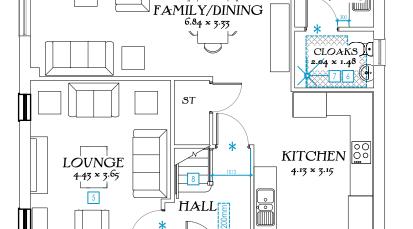

VTILITY

CRITERION 4
* - 750 MIN CLEAR WIDTH

First Floor

Ground Floor

The Harrogate M₄(2) (Cn1)

Heritage Collection "2017 Edition"


EF Series Brick (B1) 1555sqft 144.46m² DATE: November 2019 REV: A

EF_HARR_M42_DM.6


Drawing Scale 1:100 @ A3





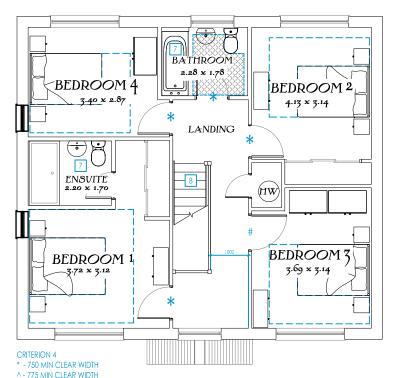



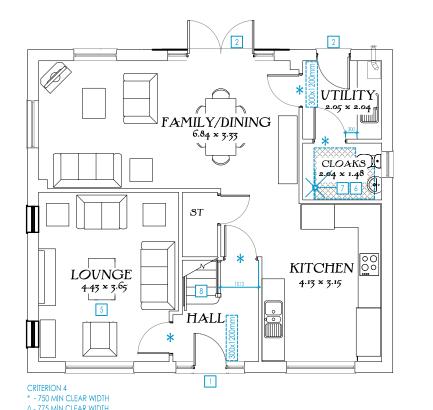

5 (m)

Ground Floor




Front Elevation



Rear Elevation



Side Elevation

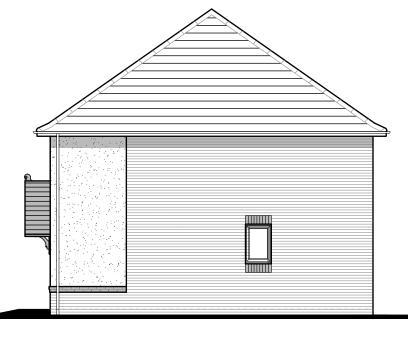

Side Elevation

Key:-

Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for
- Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- 2. All other external doors must comply with paragraph 1.3
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Harrogate M₄(2) (Cn1)


Heritage Collection "2017 Edition"

EF Series Brick (B1) 1555sqft 144.46m² DATE: November 2019 REV: A


EF_HARR_M42_DM.6

Drawing Scale 1:100 @ A3



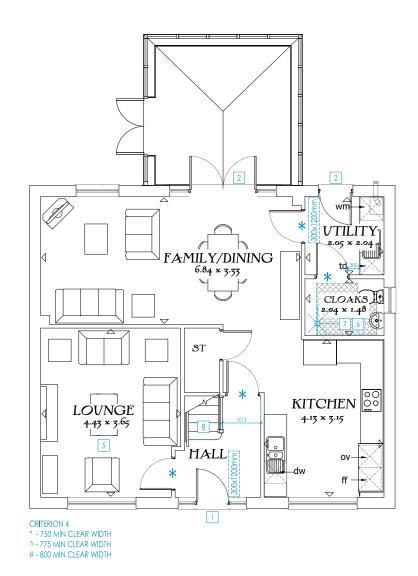

Ground Floor

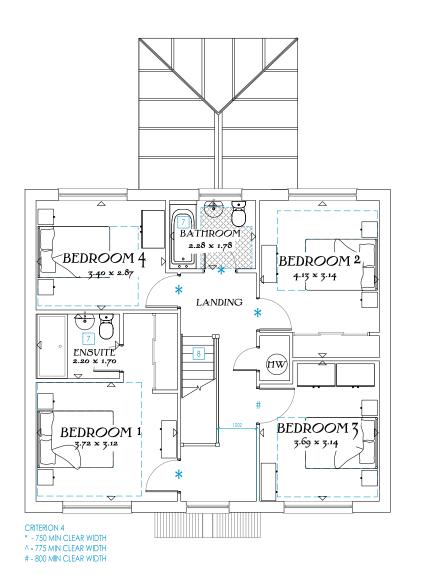

First Floor





Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Harrogate M4(2) (Conservatory)

Heritage Collection "2017 Edition"

EF Series Brick (B1) 1555sqft 144.46m² DATE: November 2019 REV: -

EF_HARR_M42_DM.6

Drawing Scale 1:100 @ A3



Scale 1:100 0 1 2 3 4 5 (m)




Front Elevation



Rear Elevation



Side Elevation

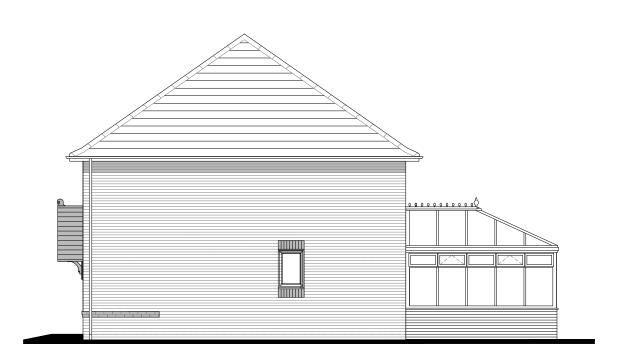

Side Elevation

Key:-



Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- Principal entrance to have
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Harrogate M4(2)

Heritage Collection "2017 Edition"

EF Series Render (A1) 1555sqft 144.46m² DATE: November 2019 REV: -

EF_HARR_M42_DM.6

Drawing Scale 1:100 @ A3



Scale 1:100 0 1 2 3 4 5 (m)




Front Elevation



Rear Elevation



Side Elevation

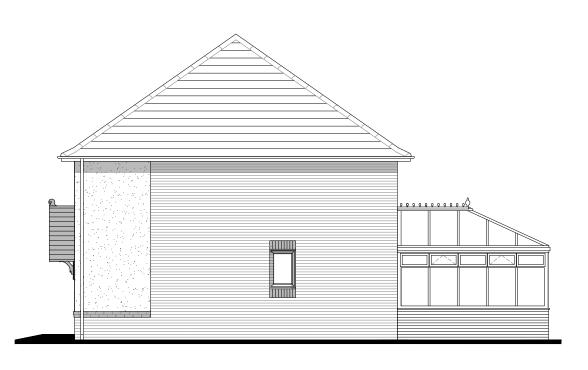

Side Elevation

Key:-



Extra items required to comply with Approved Document M4(2) shown in blue.



Clear space required in WC & Bathroom.



Number indicates item related to AD-M4(2) Criterion

Approved Document M4(2) Criteria

- 1. Principal entrance to have:
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

The Harrogate $M_4(2)$

Heritage Collection "2017 Edition"

EF Series Render (A1) 1555sqft 144.46m² DATE: November 2019 REV: -

EF_HARR_M42_DM.6

Drawing Scale 1:100 @ A3



Scale 1:100 0 1 2 3 4 5 (m)