


# - 800 MIN CLEAR WIDTH

First Floor



Ground Floor

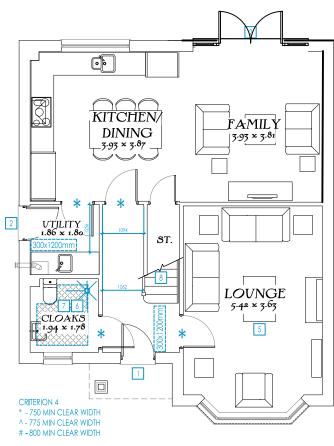

Front Elevation

Side Elevation



Rear Elevation





# Key:-



Extra items required to comply with Approved Document M4(2) shown in blue.


.

Clear space required in WC & Bathroom.

Number indicates item related to AD-M4(2) Criterion

### Approved Document M4(2) Criteria

- 1. Principal entrance to have:
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- 2. All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).




Lifertyle


Heritage Collection "2017 Edition"

EF Series Brick (B1) 1435sqft 133.34m<sup>2</sup> DATE: November 2019 REV: -


> EF\_LEAMQ\_M4(2)\_DM.1 Drawing scale 1:100 @ A3



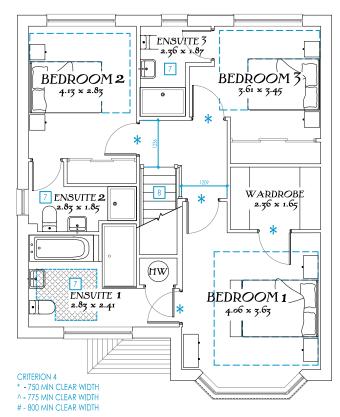




First Floor

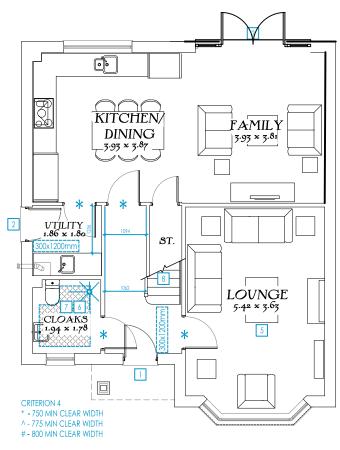

Ground Floor




Front Elevation

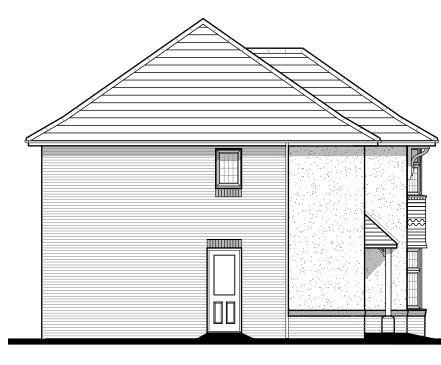

Side Elevation



Rear Elevation

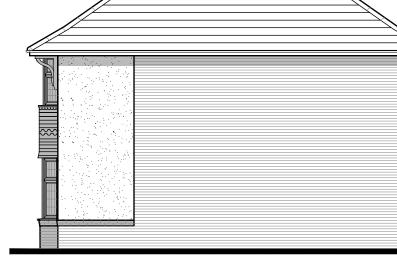





# Key:-



Extra items required to comply with Approved Document M4(2) shown in blue.

.

Clear space required in WC & Bathroom.

Number indicates item related to AD-M4(2) Criterion

## Approved Document M4(2) Criteria

- 1. Principal entrance to have:
- 1200 x 1200mm level external landing covered for 1.1. a minimum width of 900mm and depth of 600mm.
- Lighting on dusk to dawn or PIR sensor. 1.2.
- Min. clear opening width of 850mm with a 300mm 1.3. nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- 2. All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower
- 7. Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

# The Leamington $M_{4}(2)$

Life.rtyle


Heritage Collection "2017 Edition"

EF Series Render (A1) 1435sqft 133.34m<sup>2</sup> DATE: November 2019 **REV**:


EF\_LEAMQ\_M4(2)\_DM.1

Drawing scale 1:100 @ A3



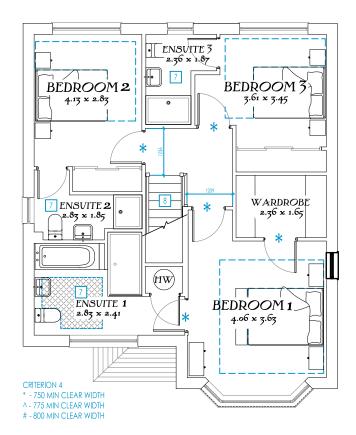

First Floor

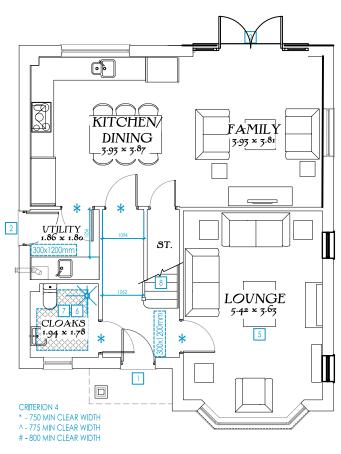

Ground Floor

3

2  4

5 (m)

Scale 1:100




Front Elevation

Side Elevation



Rear Elevation

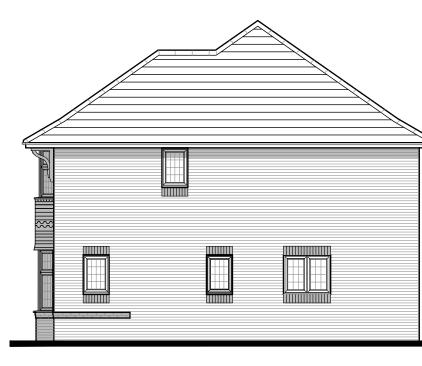

Side Elevation

## Key:-



Extra items required to comply with Approved Document M4(2) shown in blue

.

Clear space required in WC & Bathroom.

Number indicates item related to AD-M4(2) Criterion


### Approved Document M4(2) Criteria

- 1. Principal entrance to have:
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm 1.3. nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- 2. All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- 6. In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support 7. fixings (e.g. grab rails, seats and other adaptations)
- 8. 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).








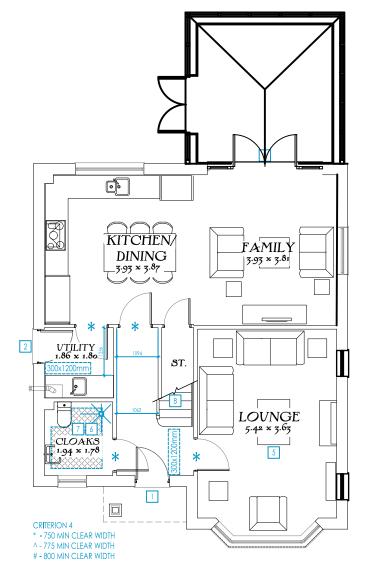

Ground Floor

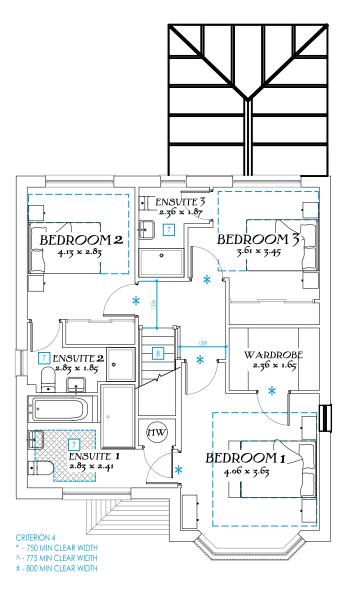

Firzt Floor



## <u>Key:-</u>



Extra items required to comply with Approved Document M4(2) shown in blue.

.

Clear space required in WC & Bathroom.

Number indicates item related to AD-M4(2) Criterion

#### Approved Document M4(2) Criteria

- 1. Principal entrance to have:
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- 2. All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).



"2017 Edition"

EF Series 1435sqft 133.34m<sup>2</sup> DATE: November 2019 REV: -

> EF\_LEAMQ\_M4(2)\_DM.1 Drawing scale 1:100 @ A3







Front Elevation

Side Elevation











## <u>Key:-</u>



Extra items required to comply with Approved Document M4(2) shown in blue.


.

Clear space required in WC & Bathroom.

Number indicates item related to AD-M4(2) Criterion

#### Approved Document M4(2) Criteria

- 1. Principal entrance to have:
- 1.1. 1200 x 1200mm level external landing covered for a minimum width of 900mm and depth of 600mm.
- 1.2. Lighting on dusk to dawn or PIR sensor.
- Min. clear opening width of 850mm with a 300mm nib on the leading edge, maintained for a minimum distance of 1200mm beyond it.
- 2. All other external doors must comply with paragraph 1.3 above
- 3. Hall or Landing clear width is 900mm.
- 4. Door clear widths as AD-M4(2) Table 2.1. 300mm nib to all doors within entrance storey.
- 5. Entrance level living space
- In a dwelling with 3 or more bedrooms, the entrance level WC also allows for a potential level access shower.
- Bathroom and WC walls / ducts / boxings can support fixings (e.g. grab rails, seats and other adaptations)
- 850mm (min.) clear width to stairs when measured 450mm above the pitch line (ignoring any newel post).

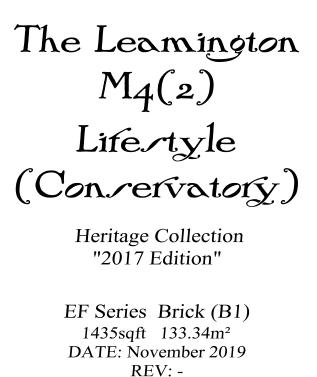

EF\_LEAMQ\_M4(2)\_DM.1 Drawing scale 1:100 @ A3

